



BSR/ASHRAE Standard 86-2013R

Public Review Draft

Method of Testing the Floc Point of Refrigeration-Grade Oils

**First Public Review (March 2023)
(Complete Draft for Full Review)**

This draft has been recommended for public review by the responsible project committee. To submit a comment on this proposed standard, go to the ASHRAE website at www.ashrae.org/standards-research-technology/public-review-drafts and access the online comment database. The draft is subject to modification until it is approved for publication by the Board of Directors and ANSI. Until this time, the current edition of the standard (as modified by any published addenda on the ASHRAE website) remains in effect. The current edition of any standard may be purchased from the ASHRAE Online Store at www.ashrae.org/bookstore or by calling 404-636-8400 or 1-800-727-4723 (for orders in the U.S. or Canada).

The appearance of any technical data or editorial material in this public review document does not constitute endorsement, warranty, or guaranty by ASHRAE of any product, service, process, procedure, or design, and ASHARE expressly disclaims such.

© 2023 ASHRAE. This draft is covered under ASHRAE copyright. Permission to reproduce or redistribute all or any part of this document must be obtained from the ASHRAE Manager of Standards, 180 Technology Parkway, Peachtree Corners, GA 30092. Phone: 404-636-8400, Ext. 1125. Fax: 404-321-5478. E-mail: standards.section@ashrae.org.

ASHRAE, 180 Technology Parkway, Peachtree Corners GA 30092

**ANSI/ASHRAE Standard 86-2013 (RA 2016),
Methods of Testing the Floc Point of Refrigeration-Grade Oils**

SECTION	PAGE
Foreword	3
1 Purpose.....	3
2 Scope	3
3 Definitions	3
4 Apparatus	4
5 Test Procedure	4
6 Reproducibility of Results.....	7
7 Significance of Results	7
8 References	7
Informative Appendix A—Round Robin Test Results.....	8
Informative Appendix B—Bibliography	9

(This foreword is not part of this standard. It is merely informative and does not contain requirements necessary for conformance to the standard. It has not been processed according to the ANSI requirements for a standard and may contain material that has not been subject to public review or a consensus process. Unresolved objectors on informative material are not offered the right to appeal at ASHRAE or ANSI.)

FOREWORD

This standard describes a standard test method for measuring the floc point (waxing tendency) of refrigeration-grade oils. Petroleum-derived oils are mixtures of large numbers of chemically distinct hydrocarbon molecules. At the low temperatures encountered in the low-pressure side of refrigeration units, some of the larger molecules separate from the bulk of the oil in the form of wax-like deposits. Wax deposition of these molecules in refrigeration systems is undesirable, as they are known to clog capillary tubes and to cause expansion valves to stick. The floc point procedure requires, in addition to the oil, a fluid in which the oil is completely miscible to a temperature below that at which floc will form. Refrigerant-12 (R-12) was selected because it fits this requirement. Refrigerant-22 (R-22), for example, cannot be used because phase separation would, generally, result before the floc point was reached. The ensuing hazing, clouding, and separation into two different layers precludes obtaining a floc point. The industry has a great deal of experience in successfully extrapolating floc point data from the test tube to field application.

Development of a floc point using some other fluid besides R-12 is feasible. However, it would require a research project and extrapolation of the data from another fluid without the field correlation, which has been available for R-12 floc point data and could result in major field problems.

1. PURPOSE

This standard provides a method for measuring the waxing tendency of refrigeration-grade oils.

2. SCOPE

The floc point measurement indicates the waxing tendency of refrigeration-grade oils at low temperatures. The floc point is defined as the highest temperature that wax or other solid substances precipitate when a mixture 10% by volume of oil and 90% by volume of R-12 is cooled under specified conditions. The results are used to compare the waxing tendency of different oils.

3. DEFINITIONS

floc point: the highest temperature at which solid substances precipitate when a mixture 10% by volume of oil and 90% by volume of R-12 is cooled under specified conditions.

flocculent: containing, or occurring in the form of, loosely aggregated particles or soft flakes.

refrigeration-grade oil: a naphthenic/paraffinic type oil that is stable with system components, will form a friction-reducing film between rubbing surfaces and seal critical clearances, and has low-temperature

transport properties for the application where it is used.

wax: higher molecular weight materials that are not soluble in R-12/mineral oil mixtures at a particular temperature.

4. APPARATUS

4.1 Cooling Bath. A cooling bath is required for obtaining the necessary temperature. It is prepared by using dry ice or a refrigeration system as the cooling source. The cooling bath shall be large enough for testing three sample tubes at one time. A large, wide-mouthed, clear Dewar flask is one cooling bath option. Dry ice in a liquid such as ethanol or acetone is required. The use of liquids such as ethanol is necessary because this liquid has the advantage of reduced frosting when the sample tube is raised from the bath for observation. A mechanical stirrer shall be provided for stirring the bath. Proper stirring is important to eliminate temperature differences. A small piece of aluminum foil in the liquid will indicate the degree of stirring obtained. If an electric motor is used, it is required to be of a type listed for use above the flammable cooling medium. A wire mesh basket with small openings shall be provided in the bath for the introduction of the dry ice so small pieces of dry ice cannot come into contact with the sample tube and cause local cold spots. The wire mesh basket can be raised or lowered to control the bath temperature.

4.2 Temperature-Measuring Devices. The temperature is measured with a precision electrical digital thermometer, a mercury thermometer, or an alcohol thermometer. ASTM standard thermometers 6F or 6C shall be used for this purpose. Thermometers shall be calibrated as prescribed by ASTM E1.¹

4.3 Sample Tube. The sample tube consists of a thick-walled borosilicate glass tube with a flared end and round bottom, as shown in Figure 1. Tube dimensions are 0.375 in. (9.5 mm) ID × 0.600 in. (15 mm) OD × 9 in. (228 mm) long. The tube shall be permanently graduated at the 0.34 oz (10.0 mL) volume (calibrated at room temperature).

4.4 Metal Connector Fittings. The metal connector fittings shall be as shown in Figure 1.

4.5 Graph Paper. In certain instances, graph paper is used with a glass plate to judge the cloudiness of the test sample. The graph shall have 20 lines per 1.0 in. (25.4 mm).

4.6 Mechanical Vacuum Pump. A mechanical vacuum pump that provides an absolute pressure of 13.3 Pa (0.1 mm Hg) shall be used.

5. TEST PROCEDURE

5.1 Use personal protective equipment (PPE), including a face mask, protective shield, and heavy gloves when handling the charged pressure tube outside the cooling bath and when evacuating the tube. The glass tube is under pressure and a hazard exists whenever the temperature is above -21°F (-30°C). When using ethanol or acetone, take appropriate precautions to prevent fire. These solvents and their vapors are very flammable.

Do not use a glass tube at a pressure exceeding 80 psig (552 kPa) or temperature exceeding 200°F (93°C).

The tube shall not be subjected to any bending strain. Inspect the glass components for wear on a regular basis. Erosion, stress, cracks, nicks, or deep scratches provide early warning of the need for glass replacement. The glass may erode evenly so wear is not visibly noticeable. If wear is detected, replace the component to eliminate the potential cause of breakage.

5.2 The sample tube shall be cleaned, dried, and stored in a desiccator prior to use. Appropriate precautions shall be taken to eliminate the introduction of water into the sample tube while charging with oil or refrigerant. Prepare a manifold or other system for evacuating and charging the sample tube. The refrigerant tubing shall be dried before use.

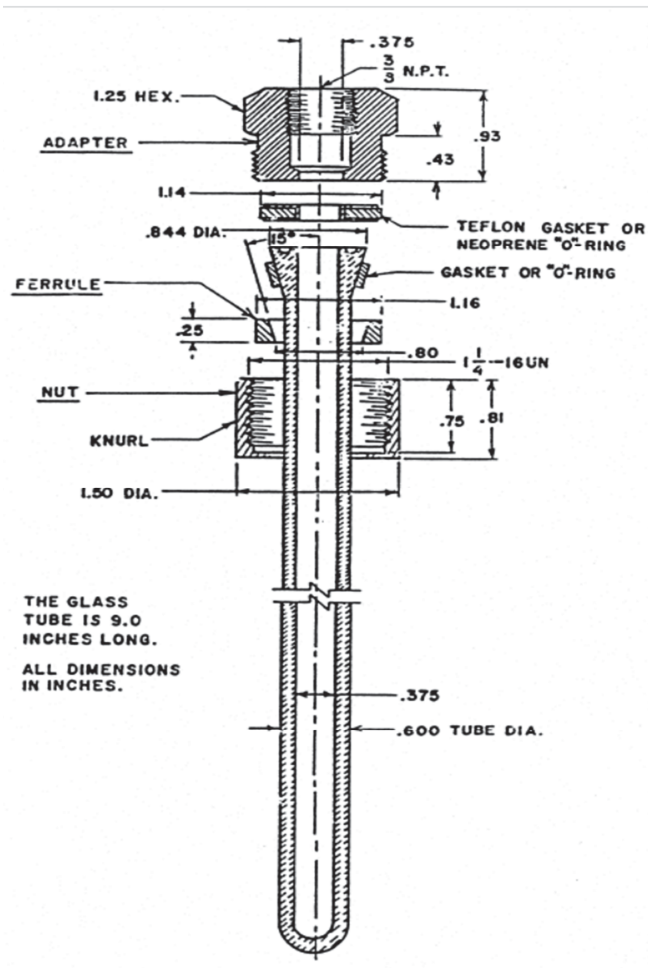


Figure 1 Floc tube with metal connector.

5.3 Make sure that stirring of the liquid creates a uniform temperature within the cooling bath. Install the thermometer in a tube with the same tube dimensions as the floc tube. Immerse the tube in the bath and fill it with the same fluid used in the cooling bath.

5.4 Transfer 0.03 oz (1.0 mL) of the sample oil into the sample glass tube using a 0.07 oz (2.0 mL) syringe for precise oil measurement (at room temperature). Attach a small brass valve to the sample tube using the metal connector fittings. Evacuate the sample tube to 13.3 Pa (0.1 mm Hg) absolute pressure to de-gas the oil.

5.5 Introduce a quantity of liquid R-12 so that the total volume of oil and R-12 is 0.34 oz (10.0 mL). The method of introduction shall preclude the introduction of water into the tube. This addition of R-12 and the measurement of the volume shall be done in the cooling bath at a temperature of –25°F to –30°F (–32°C to –34°C).

5.6 The tube shall be disconnected from the charging assembly and allowed to warm up to the point where the refrigerant/oil mixture is made homogeneous by shaking.

Informative Note: Use proper PPE. Any overcharged R-12 can then be bled off at a temperature above –20°F (–29°C). In this way, the volume of the refrigerant/oil mixture is to be adjusted to 0.34 oz (10.0 mL) when measured at –25°F to –30°F (–32°C to –34°C).

5.7 The sample tube containing the refrigerant/oil mixture shall then be immersed in the cooling bath that has previously been adjusted to a temperature of 0°F (–18°C). Then the temperature of the cooling bath shall be lowered at a rate of 1°F to 2°F (0.5°C to 1°C) per minute by systemic addition of dry ice or using a controlled chilling device. Temperature readings with the thermometer or thermocouple in the test tube in the bath give values comparable to the temperature in the test sample tube.

5.8 If an oil shows a cloud at 0°F (–18°C), the test shall be repeated to make certain that water has not been inadvertently introduced into the oil during the charging operation. If an oil is wet, it is to be dried by heating the oil under vacuum or in an open container at 302°F (150°C) for one hour while bubbling nitrogen into the oil.

5.9 The tube shall be observed as the temperature is lowered, beginning at 0°F (–18°C). If a clear Dewar flask is used, the tube is to be viewed through the Dewar flask. The tube is to be removed briefly (10 seconds) from the cooling bath for viewing. Do not disturb the content; this is to be done by removing the tube slowly, without shaking. When distinct flocculent material is observed in the mixture, the test thermometer or thermocouple in the bath shall be read. This temperature shall be reported as the floc point. Certain oils show a haze at temperatures of 5°F to 10°F (3°C to 6°C) above the actual floc point.

5.10 In some instances, the mixture becomes increasingly hazy or cloudy as the temperature is lowered but does not form distinct flocculent material. When this occurs, the tube shall be removed from the cooling bath and held against a glass plate with graph paper (see Section 4.5) behind the glass plate. When the cloudiness in the tube prevents seeing the lines on the graph paper, then the temperature shall be read, and this condition shall be an endpoint to the floc point test. **Informative note:** The same tube is suitable for a repeat test.

5.11 Repeat the test with a second oil sample, run at a different time. If the results of these two observations agree within 5°F (3°C), the average of the two shall be reported as the floc point of the oil.

6. REPRODUCIBILITY OF RESULTS

Duplicate determinations of floc point by the same operator in the same laboratory shall agree within 5°F (3°C). Duplicate determinations between two different laboratories are suspect if it differs by more than 15°F (8°C). This reproducibility requirement is based on a round robin test conducted in 1982 by seven laboratories using three oil samples (see Informative Appendix A). The results were evaluated using the ASTM E691, *Standard Practice for Conducting an Inter-laboratory Study to Determine the Precision of a Test Method*.²

7. SIGNIFICANCE OF RESULTS

The floc point is used to compare the waxing tendencies of different oils. In actual refrigeration systems, different refrigerant and oil concentrations are encountered, so test results cannot be used to directly predict actual system performance. The oil concentration in the expansion devices of common refrigeration and air-conditioning systems is lower than 10% by volume, resulting in a significantly lower temperature at which wax will separate from the refrigerant/oil mixture.

8. REFERENCES

1. ASTM E1-2014, *Standard Specification for ASTM Liquid-in-Glass Thermometers*, ASTM International, West Conshohocken, PA.
2. ASTM E691-2018, *Standard Practice for Conducting an Interlaboratory Study to Determine the Precision of a Test Method*, ASTM International, West Conshohocken, PA.

(This appendix is not part of this standard. It is merely informative and does not contain requirements necessary for conformance to the standard. It has not been processed according to the ANSI requirements for a standard and may contain material that has not been subject to public review or a consensus process. Unresolved objectors on informative material are not offered the right to appeal at ASHRAE or ANSI.)

INFORMATIVE APPENDIX A— ROUND ROBIN TEST RESULTS

Table A1 is a summary of the data from seven independent laboratories that provided floc points on three oil types.

TABLE A1 Round Robin Test Results—Test Conducted June 1982*

LAB	Floc Point, °F			Floc Point, °C		
	Oil A	Oil B	Oil C	Oil A	Oil B	Oil C
1	-94, -93	-60, -60	-48, -49	-70, -70	-51, -51	-44, -45
2	-89, -92	-67, -66	-50, -58	-67, -69	-54, -55	-46, -50
3	—	-73, -72	-42, -38	—	-58, -58	-41, -39
4	-77, -82, -81	-48, -52, -52	-41, -38, -43	-61, -63, -63	-44, -47, -47	-41, -39, -42
5	-80, -79, -80	-57, -56, -56	-39, -39, -40	-62, -62, -62	-50, -49, -49	-39, -39, -40
6	-91, -87	-60, -55	-45, -44	-68, -66	-51, -48	-43, -42
7	-75, -75	—	-52, -48	-60, -60	—	-47, -44

* Data developed by project committee members for the 1983 edition of this standard.

This appendix is not part of this standard. It is merely informative and does not contain requirements necessary for conformance to the standard. It has not been processed according to the ANSI requirements for a standard and may contain material that has not been subject to public review or a consensus process. Unresolved objectors on informative material are not offered the right to appeal at ASHRAE or ANSI.)

INFORMATIVE APPENDIX B— BIBLIOGRAPHY

Deutsche Normen DIN-51351, Testing of Lubricants: Determination of Flocc Point of Refrigerator Oils.

Deutsche Normen DIN-51590 Part 2, Determination of the R-12 Insolubles Content of Refrigeration Oils— Procedure at 40°C.

“Kinetic” Technical Bulletin 14, Handling ‘Freon’ Fluorinated Hydrocarbon Compounds in the Laboratory