



**BSR/ASHRAE Addendum b
to ANSI/ASHRAE Standard 127-2020**

Public Review Draft

**Proposed Addendum b to Standard
127-2020, *Method of Testing for Rating Air-Conditioning
Units Serving Data Center (DC) and Other Information
Technology Equipment (ITE) Spaces***

**First Public Review (October 2025)
(Draft Shows Proposed Changes to Current Standard)**

This draft has been recommended for public review by the responsible project committee. To submit a comment on this proposed standard, go to the ASHRAE website at www.ashrae.org/standards-research--technology/public-review-drafts and access the online comment database. The draft is subject to modification until it is approved for publication by the Board of Directors and ANSI. Until this time, the current edition of the standard (as modified by any published addenda on the ASHRAE website) remains in effect. The current edition of any standard may be purchased from the ASHRAE Online Store at www.ashrae.org/bookstore or by calling 404-636-8400 or 1-800-727-4723 (for orders in the U.S. or Canada).

This standard is under continuous maintenance. To propose a change to the current standard, use the change submittal form available on the ASHRAE website, www.ashrae.org.

The appearance of any technical data or editorial material in this public review document does not constitute endorsement, warranty, or guaranty by ASHRAE of any product, service, process, procedure, or design, and ASHRAE expressly disclaims such.

© 2025 ASHRAE. This draft is covered under ASHRAE copyright. Permission to reproduce or redistribute all or any part of this document must be obtained from the ASHRAE Manager of Standards, 180 Technology Pkwy NW, Peachtree Corners, GA 30092. Phone: 404-636-8400, Ext. 1125. Fax: 404-321-5478. E-mail: standards.section@ashrae.org.

ASHRAE, 180 Technology Pkwy NW, Peachtree Corners, GA 30092

[Note to Reviewers: This is a review of Independent Substantive Changes that were made since the last Public Review. Text that was removed from the Public Review Draft is provided for reference but is shown in ~~strikeout~~, and text that has been added is shown with underlines.]

Addendum b to 127-2020

Addendum b to Standard 127 adds new sections and renumbers the Table of Contents as shown:

CONTENTS

ANSI/ASHRAE Standard 127-2020

Method of Testing for Rating ~~Air-Conditioning Units~~ Cooling Equipment Serving Data Center (DC) and Other Information Technology Equipment (ITE) Spaces

SECTION	PAGE
Foreword	2
1 Purpose	2
2 Scope	2
3 Definitions	2
4 Classification	<u>46</u>
5 Rating Requirements	<u>48</u>
6 <u>Calculations and Conversions</u>	14
7 <u>Test Requirements</u>	19
8 <u>Data to be Recorded</u>	<u>22</u>
9 <u>Test Procedures</u>	<u>23</u>
10 <u>Reporting of Results</u>	<u>24</u>
11 <u>Nomenclature</u>	<u>26</u>
12 Conformance	<u>1228</u>
13 References	<u>1329</u>
Normative Appendix A: Test Ducts for Measuring Airflow Rate and Static Pressure on All Downflow Units and Those Upflow Units in Limited-Height Test Chamber	<u>1430</u>
Normative Appendix B: Climate Zone Bin Data with Population Weighting	<u>1632</u>
Normative Appendix C: Test Setup Packaged AHU for Outdoor Installation	<u>1733</u>
Normative Appendix D: Test Setup Rear-Door Heat Exchanger	<u>1834</u>
Normative Appendix E: System Configuration	<u>1935</u>
Informative Appendix F: Performance Rating Table from AHRI 1360	<u>2743</u>
<u>Informative Appendix G: Use of standard for Application Testing</u>	<u>44</u>
<u>Normative Appendix H: Measurement Points for Liquid to Liquid CDUs</u>	<u>45</u>

Addendum b to Standard 127 adds the following definitions to the existing Section 3. When merged they will be listed in alphabetical order as follows:

3. DEFINITIONS

auxiliary power: see *power*.

CDU operating conditions: Unit operation under specified steady-state conditions. TCS flow rate, FWS flow rate, TCS Fluid properties, FWS fluid properties, entering (and leaving) TCS temperature, entering (and leaving) FWS temperatures

CDU thermal efficiency: the ratio of net heat absorbed by the FWS fluid removed from the TCS fluid divided by the net heat removed from the TCS fluid absorbed by the FWS fluid expressed as a percentage. [informative note] This is also the CDU FWS Load divided by the CDU Net Capacity at the CDU Operating Point expressed as a percentage.

CDU FWS load: the net heat transferred directly from the CDU to the FWS fluid at the specified CDU operating point. This value explicitly excludes heat transferred from the CDU to the FWS fluid by way of room air-cooling equipment or systems.

CDU net capacity: the net heat removed from the TCS fluid at the specified CDU operating point.

CDU thermal losses: the net heat rejected from the CDU to space ambient air. This measurement includes both convective and radiative heat.

COP_C: coefficient of performance; the cooling efficiency expressed as a dimensionless ratio of net cooling capacity divided by the total-critical input power.

energy balance: a dimensionless ratio metric used to check for gross errors in measurement instrumentation and test results (with or without a heat reclaim heat exchanger) and defined as the difference between energy inputs and energy outputs to the CDU package, normalized to a percentage by dividing by the mean of the total input energy and the total output energy. For this standard, the energy inputs are generally limited to the gross cooling capacity and the critical input power, although other auxiliary power inputs are included when analysis demonstrates significance to the energy balance.

flow turndown: the ratio of the unit rated flow and the unit minimum flow rate at which flow can automatically be maintained within the stability requirements of this standard.

Facility water system (FWS): A dedicated fluid loop intended to transport the heat from the data center cooling equipment to heat rejection equipment and systems. Heat rejection equipment and systems may include, but are not limited to, dry coolers, chillers, cooling towers, and heat recovery and reuse systems.

FWS pumping losses: the power consumed by facility pumps to circulate water through the FWS side of the CDU. The measurement includes the pressure drop from FWS entering connection to FWS leaving connection and utilizes an assumed standard pump and pump motor efficiency. All manufacturer required appurtenances internal to the CDU will be installed during the test.

Liquid to Liquid (Single Phase) Coolant Distribution Unit (CDU) for Information Technology Equipment: A heat exchange assembly or collection of components, “Assembly,” that separates the technology cooling system (TCS) coolant from the facility water system (FWS) or intermediate heat rejection system coolant (a liquid, which may or may not be water or a mixture of additives with water) where both coolants remain in the liquid phase and no heat is transferred through phase change. A heat rejection cooling capacity or capacities may be defined for this Assembly based on the heat rejected from the TCS coolant at a specified operating point or points using a specified coolant. The Assembly will have a measurable approach temperature for each operating point. A TCS coolant delivery flow rate may be defined for this Assembly based on the coolant flow that is generated by the Assembly at a given coincident pressure differential, fluid composition and temperature. The Assembly will have a measurable efficiency at the specified operating points.

operating condition tolerance: the maximum permissible variation between the time-averaged measurement data observations and the specified (target) operating conditions as established in the test plan.

auxiliary power: net real electrical power consumed by auxiliary devices that are not integral to the operation of the CDU. Auxiliary devices can include, but are not limited to network switches, external devices, or any devices consuming electrical power not critical to CDU function.

critical input power: net real electrical power input to the CDU powering any of the following:

1. Pumps

2. Variable speed drives
3. Controls and instrumentation
4. Cooling fans or other equipment cooling apparatus
5. Any electrically powered device critical to the function of the CDU

total input power: the sum of critical input power and auxiliary power to all components of a CDU.

published ratings: a statement of the assigned values of those performance characteristics, under ~~stated design conditions~~ rating conditions, by which a unit may be chosen to fit its application. These values apply to all units of like nominal size and type or model (identification) produced by the same manufacturer. The term “published rating” includes the rating of all performance characteristics, at stated rating conditions, shown on the unit or published in specifications, advertising, or other literature controlled by the manufacturer at stated rating conditions.

application rating: a rating based on tests performed at design application rating conditions other than standard ~~design rating~~ conditions.

TCS external pump head available: the net head pressure available at the CDU rated TCS flow rate to circulate TCS fluid through the facility TCS piping network. The value is measured from the TCS supply connection to the TCS return connection.

technology cooling system (TCS): A dedicated fluid loop intended to perform heat transfer directly from the IT equipment into the Facility Water System (FWS)

FWS total heat rejection: heat rejected to the FWS loop by the CDU as measured at the CDU FWS connections.

Modify Section 4 as shown:

4. CLASSIFICATION

4.2 Normally, coolant distribution units (CDUs) within the scope of this standard can be classified as shown below.

4.2.1 **Liquid to Liquid.** A unit that removes heat from a liquid phase TCS fluid and rejects heat to a liquid phase FWS fluid.

6. CALCULATIONS AND CONVERSIONS

Addendum b to Standard 127 rennumbers existing Section 6 to Section 12. The new Section 6 is as follows:

6.1 Fluid Properties

6.1.1 Water.

6.1.1.1 Use NIST Reference Fluid Thermodynamic and Transport Properties Database (REFPROP): Version 10 to calculate physical properties such as density, specific heat, or enthalpy as a function of both pressure and temperature.

6.1.2 Other Liquids.

6.1.2.1 Physical properties of the liquid versus temperature, and by concentration for solutions or mixtures, shall be determined from published data sources such as manufacturer data sheets. Systems using aqueous solutions or mixtures shall be tested to

measure or determine the concentration by mass of the liquid. Concentration tests shall be performed within two (2) weeks or less prior to the date of the CDU tests, or within two (2) days after the tests.

6.2 Data Processing.

6.2.1 Data-point measurements collected during the duration of the testing period shall be processed to calculate sample mean and sample standard deviation per the equations provided in ASHRAE 30.

6.3 Redundant Measurements

6.3.1 When redundant sensors are used to measure the same property, the average of the sample means shall be used with associated uncertainty when calculating results. Utilize equations provided in ASHRAE 30.

6.4 Performance

6.4.1 Capacity. One of the following three methods shall be used depending on the available measurements and with consideration of the acceptable test uncertainty required by the parties. The sign convention, positive or negative, is to show all capacity values as positive, whether energy is input into the CDU system or energy is removed from the CDU system. Adjust the sign for temperature difference accordingly by subtracting the lesser of inlet and outlet from the greater value. For pressure difference, however, the sign is significant with respect to the direction of energy flow.

6.4.1.1 Gross Capacity and Net Capacity Given Liquid Volume Flow Rate, Inlet and Outlet Temperatures, Pressure Loss, Density, and Specific Heat. Use equations provided in ASHRAE 30.

6.4.1.2 Gross Capacity and Net Capacity Given Liquid Mass Flow Rate, Inlet and Outlet Temperatures, Pressure Loss, Density, and Specific Heat. Use equations provided in ASHRAE 30. Temperature Difference, Enthalpy Difference, and Pressure Difference. Use equations provided in ASHRAE 30.

6.4.2 Power

6.4.2.1 For use in efficiency calculations, determine the CDU ~~total~~ Critical Input Power, by summation, including all power inputs – thermal or electrical – to the components identified in the Critical Input Power definition. ~~pump and all auxiliary power requirements and any heat inputs to the prime mover.~~

$$W_{input} = \sum_i W_i + \sum_j Q_j$$

$$U_{W_{input}} = \sqrt{\sum_i [(\theta_{W_i} U_{W_i})^2] + \sum_j [(\theta_{Q_j} U_{Q_j})^2]}$$

$$\theta_{W_i} = 1$$

$$\theta_{Q_j} = 1$$

6.4.2.2 For use in energy balance calculations, determine the portion of the total ~~critical~~ power that is transferred into the fluid circuit.

$$W_{fluid} = \sum_i W_i$$

$$U_{W_{fluid}} = \sqrt{\sum_i [(\theta_{W_i} U_{W_i})^2]}$$

$$\theta_{w_i} = 1$$

6.4.3 Energy Efficiency. The coefficient of performance (COP) is defined in the following sections. Other efficiency metrics are derived as variations on the ratio of capacity and input work, or its inverse, and may be used according to the definitions in Section 3.

6.4.3.1 Cooling Energy Efficiency. The cooling coefficient of performance η_{CDU} shall be calculated using the following:

$$\eta_{CDU} = \frac{Q}{W_{TCS}}$$

$$U_{\eta_{CDU}} = \sqrt{(\theta_Q U_Q)^2 + (\theta_{W_{TCS}} U_{W_{TCS}})^2}$$

$$\theta_Q = \frac{1}{W_{TCS}}$$

$$\theta_{W_{TCS}} = \frac{Q}{W_{TCS}^2}$$

6.4.4 Liquid Pressure Drop Correction. Measured liquid pressure-drop values shall be adjusted to subtract additional static pressure drop due to piping external to the CDU connection points. The additional static pressure drop shall be the sum of all losses between the unit connections and the location of static pressure taps. Record the original measured value, the calculated adjustment value, and the final calculated result for liquid pressure drop. Where applicable, refer to ASHRAE 30 for equations, processes, and procedures.

6.5 Validation. Test results are validated by checking an energy balance and a voltage balance.

6.5.1 Energy Balance. Based on the first law of thermodynamics (the law of conservation of energy), an energy balance calculation evaluates all of the measured energy flow into and out of a control volume. If there is a nonzero difference between energy flow in and energy flow out, greater than the energy balance measurement uncertainty, then either (a) the system is not at steady state (lack of equilibrium), (b) some significant heat gain or heat loss has been omitted from the calculation, or (c) there is a measurement error to be corrected. The control volume shall include the entire CDU package. In many cases, heat losses or heat gain caused by radiation, convection, bearing friction, etc., are relatively small and may be either included or excluded without a problem in the overall energy balance.

6.5.1.1 Refer to ASHRAE 30 for equations, processes, and procedures. For liquid to liquid CDUs, ~~the measured input power shall include power to the pump plus the power to control system~~ utilize the definition of Critical Input Power in this standard.

6.5.1.2 A typical summation omitting the effect of the small heat losses and gains mentioned in Section 5.5.1.2:

$$E_{in} = \sum_i E_{in_i} = Q + (W_{TCS})$$

6.5.2 Voltage Balance.

6.5.2.1 Refer to ASHRAE 30 for equations, processes, and procedures.

6.5.3 All equations described in this standard assume consistent units. It is imperative that users of this standard ensure proper unit conversions in all calculations.

6.5.4 One (1) Btu_{IT} = 1055.05585262 J (exact conversion).

6.5.5 For all other unit conversions, refer to NIST Special Publication 811, *Guide for the Use of the International System of Units (SI)*³, or other authoritative source for appropriate unit conversions.

6.6 Rounding and Significant Digits

6.6.1 Refer to ASHRAE 30 for equations, processes, and procedures.

Addendum b to Standard 127 rennumbers existing Section 7 to Section 13. The new Section 7 is as follows:

7. TEST REQUIREMENTS

7.1 Except where specifically stated within this standard, follow the requirements identified in ASHRAE 30. References to chillers should be replaced with CDU. References to chilled water should be replaced with FWS. References to condenser water should be replaced with TCS.

Table 7-1 Requirements for Test Instrumentation

<i>Measurement</i>	<i>Measurement System Accuracy^{b,c,d,e}</i>	<i>Measurement Resolution^{f,g}</i>	<i>Selected, Installed, Operated, Maintained in Accordance with</i>
<i>Liquid Fluid temperature</i>	$\pm 0.11 \Delta^{\circ}\text{C}$ ($\pm 0.2 \Delta^{\circ}\text{F}$)	0.005°C (0.01°F)	<i>ANSI/ASHRAE Standard 41.1^{4,14}</i>
<i>Air temperature</i>	$\pm 0.11 \Delta^{\circ}\text{C}$ ($\pm 0.20 \Delta^{\circ}\text{F}$)	0.05°C (0.1°F)	<i>ANSI/ASHRAE Standard 41.1^{4,14}</i>
<i>Liquid Fluid mass flow rate^a</i>	$\pm 1.0\%$ RDG	4 significant figures	<i>ANSI/ASHRAE Standard 41.8^{5,15} or ASME Power Test Code PTC 19.5^{6,16} (flow measurement)</i>
			<i>ASME MFC-16^{7,17} (electromagnetic type)</i>
			<i>ASME MFC-3M^{8,18} (orifice and venturi type)</i>
			<i>ASME MFC-6M^{9,19} (vortex type)</i>
			<i>ASME MFC-11^{10,20} (Coriolis type)</i>
			<i>ASME MFC-21.2 (thermal dispersion)</i>
			<i>ISA Standard RP31.1^{11,21} (turbine type)</i>
<i>Differential pressure</i>	$\pm 1.0\%$ RDG	3 significant figures	<i>ASME Power Test Code PTC 19.2^{12,22}</i>
<i>Electrical power</i>		4 significant figures	<i>ANSI/ASHRAE Standard 41.11^{13,23}</i> <i>IEEE C57.13^{14,24}</i>
$\leq 600 \text{ V}$	$\pm 1.0\%$ FS, $\pm 2.0\%$ RDG	(V, A, kW, Hz)	
$> 600 \text{ V}$	$\pm 1.5\%$ FS, $\pm 2.5\%$ RDG		
<i>Atmospheric pressure</i>	$\pm 1.0 \text{ kPa}$ ($\pm 0.15 \text{ psia}$)	0.1 kPa (0.01 psia)	<i>ASME Power Test Code PTC 19.2^{12,22}</i>

a. Accuracy requirement also applies to volumetric type meters.

b. Measurement system accuracy shall apply over the range of use during testing, as indicated by the turndown ratio determined during calibration—i.e., from full scale down to a value of full scale divided by the turndown ratio. For many types of instruments and/or systems, this may require exceeding the accuracy requirement at full scale.

c. %RDG = percent of reading; %FS = percent of full scale for the usable range of the measurement instrument or measurement system.

d. If dual requirements are shown in the table, FS and RDG, then both requirements shall be met.

e. Current transformers (CTs) and potential transformers (PTs) shall have a metering accuracy class of 0.3 or better, rated in accordance with IEEE C57.13.

f. Measurement resolution shown is the minimum requirement (most coarse resolution allowable). Better (finer) resolution is acceptable for instrument or panel displays or computer screen displays. Resolution includes all parts of the measurement system, such as analog-to-digital conversion.

g. Significant figures (also known as significant digits) are determined in accordance with Section 5.7.

Table 7-2 Definition of Operating Condition Tolerances and Stability Criteria

Measurement or Calculation Result		Applicable Operating Modes	Values Calculated from Data Samples		Operating Condition Tolerance Limits	Stability Criteria	
			Mean	Std. Dev.			
Net capacity (cooling or heating)		Cooling, heating, heat recovery	$\overline{Q}$	—	Unit with continuous unloading: Part-load test capacity shall be within 2% of the target part-load capacity ^a . $\frac{Q_{part-load} - Q_{target}}{Q_{100\%}} \leq 2.000\%$	No requirement	
					Units with discrete capacity steps: Part-load test points shall be taken as close as practical to the specified part-load rating points as stated in the test plan.		
FWS	Entering fluid <u>water</u> temperature	Cooling	$\overline{T}$	s_T	No requirement	$s_T \leq 0.10 \text{ } \Delta^{\circ}\text{C} [0.18 \text{ } \Delta^{\circ}\text{F}]$	
	Leaving water <u>fluid</u> temperature				$T _{T_{target}} \leq 0.28 \text{ } \Delta^{\circ}\text{C} [0.50 \text{ } \Delta^{\circ}\text{F}]$		
TCS	Entering Leaving <u>water</u> fluid temperature				No requirement		
	Leaving Entering <u>water</u> fluid temperature						

- a. The $\pm 2.0\%$ tolerance shall be calculated as 2.0% of the full load rated capacity (kW). For example, a nominal 50.0% part-load point shall be tested between 48.0% and 52.0% of the full-load capacity to be used directly for ~~IPLV-SI and NPLV-SI efficiency~~ calculations. Outside this tolerance, interpolation shall be used.
- b. For electrically driven machines, voltage and frequency shall be maintained at the nameplate rating values within tolerance limits and stability criteria on voltage and frequency when measured at the locations specified in Section 6.3.1.7. For dual nameplate voltage ratings, tests shall be performed at the lower of the two voltages.
- c. For speed-controlled pumps, the speed shall be maintained at the nameplate rating value within the tolerance limits.

Table 7-3 Definition of Operating Condition Tolerances and Stability Criteria (Continued)

Measurement or Calculation Result	Applicable Operating Modes	Values Calculated from Data Samples		Operating Condition Tolerance Limits	Stability Criteria
		Mean	Std. Dev.		
FWS or TCS ^c	Cooling	T	s_T	$T = T_{target} \pm 0.56 \Delta^\circ\text{C} [1.00 \Delta^\circ\text{F}]$	$s_T \leq 0.42 \Delta^\circ\text{C} [0.75 \Delta^\circ\text{F}]$
Water-Fluid flow (volumetric, entering)	Cooling	$\overline{V_w}$	s_{V_w}	$\overline{V_w} = V_{w, target} \pm 5.000\%$	$s_{V_w} \leq 0.750\%$
Voltage ^d (If multiphase, this is the average of all phases.)		$\overline{V}$	s_V	$\overline{V} = V_{target} \pm 10.00\%$	$s_V \leq 0.500\%$
Frequency ^d		$\overline{\omega}$	s_ω	$\overline{\omega} = \omega_{target} \pm 1.000\%$	$s_\omega \leq 0.500\%$
Governor control pump speed ^f		n	s_n	$n = n_{target} \pm 0.500\%$	$s_n \leq 0.250\%$

a. The $\pm 2.0\%$ tolerance shall be calculated as 2.0% of the full load rated capacity (kW). Outside this tolerance, interpolation shall be used.

b. For electrically driven machines, voltage and frequency shall be maintained at the nameplate rating values within tolerance limits and stability criteria on voltage and frequency when measured at the locations specified in Section 6.3.1.7. For dual nameplate voltage ratings, tests shall be performed at the lower of the two voltages.

c. For speed-controlled pumps, the speed shall be maintained at the nameplate rating value within the tolerance limits.

Addendum b to Standard 127 adds Sections 8 through 11 as follows:

8. DATA TO BE RECORDED

8.1 Primary Data. Table 8-1 summarizes the data to be recorded during the test for each of the data point samples.

Table 8-1 Data to be Recorded During the Test

<i>Type</i>		<i>Data Item</i>
<i>All types</i>	<i>General</i>	<i>Time of day for each data point sample</i>
		<i>Atmospheric pressure</i>
	<i>FWS, TCS</i>	T_{in}
		T_{out}
		m_w or V_w
<i>Electric drive</i>	<i>CDU</i>	Δp_{test}
		W_{input}
		<i>Voltage for each phase</i>
		<i>If three-phase, average voltage</i>
		<i>Frequency for one phase</i>

Table 8-2 Auxiliary Data to Be Recorded

<i>Type</i>	<i>Data Item</i>
<i>All</i>	<i>Date, place, and time of test.</i>
	<i>Names of test supervisor and witnessing personnel.</i>
	<i>Ambient temperature at test site within test cell^a.</i>
	<i>Nameplate data, including make, model, size, serial number, and refrigerant designation numbers <u>or</u> Manufacturer's fluid designation (Product name, generic industry name, and batch number <u>or</u> chemistry test results per 6.2.1) for FWS and TCS fluids, sufficient to completely identify the CDU. Unit voltage and frequency shall be recorded.</i>
	<i>Prime mover nameplate data (motor, engine, or turbine).</i>

a. Test cell temperature is not subject to the stability requirements identified in Table 7-3

Table 8-3 Optional Auxiliary Data to Be Recorded

<i>Type</i>	<i>Data Item</i>
<i>Open-type pump</i>	<i>Pump rotational speed.</i>
<i>Electric drive</i>	<i>Current for each phase of electrical input to CDU</i>
<i>All</i>	<i>Liquid pump input power for integral pumps.</i>

8.2 Auxiliary Data. Table 8-2 summarizes the auxiliary data that shall be recorded for the test.

8.3 Optional Auxiliary Data. Table 8-3 summarizes optional auxiliary data (nonmandatory) that may be recorded during the test for diagnostic information.

8.4 Refer to Normative Appendix B for schematics of each system type and the physical location of measurement instruments.

9. TEST PROCEDURES

9.1 Purpose. This section prescribes a method of testing for liquid-to-liquid CDUs and to verify capacity and power requirements at a specific set of steady-state conditions.

9.1.1 Testing shall be conducted at a facility designed specifically for that purpose where instrumentation is in place and load stability can be obtained.

9.1.2 Testing shall not be conducted in field installations to the provisions of this standard. Steady-state conditions and requirements for consistent, reliable measurement are difficult to achieve in field installations.

9.2 Test Procedures. For each test point at a specific load and set of operating conditions, the test will measure capacity, critical input power, and liquid-side pressure drop. Capacity is a measurement of the heat removed from the liquid as it passes through the heat exchanger according to the test plan. Net capacity is always required, and gross capacity is required when an energy balance requirement applies. Each test point will collect multiple data points versus time. The test shall use instrumentation meeting the requirements in Section 4 and calculations in Section 3.

9.3 Setup. The CDU to be tested shall be set up at the test facility in accordance with the manufacturer's instructions, including but not limited to support of installation mounting points, connections for liquid, connections for power supply, test instrumentation, etc. Noncondensable gases, if present, shall be removed from the system.

9.3.1 The test cell must maintain an ambient dew point temperature no less than 2.0°C below the TCS Leaving Fluid Temperature for the Rating Conditions.

9.4 Condition of Heat Transfer Surfaces. The as-tested fouling factors shall be assumed to be zero ($R_{foul} = 0.000 \text{ m}^2 \cdot \text{K/kW} = 0.00 \text{ h} \cdot \text{ft}^2 \cdot ^\circ\text{F/Btu}$). Tests conducted in accordance with this standard may require cleaning of the heat transfer surfaces (in accordance with manufacturer's instructions) prior to conducting the test.

9.5 Operation. After setup is complete, the CDU will be started and operated to attain the target conditions of the test point per the test plan. The CDU is not required to operate continuously between different test points; shut down and restart between test points is allowable.

9.5.1 General.

9.5.1.1 Refer to ASHRAE 30 for requirements.

9.5.2 Adjustments

9.5.2.1 Controls. Manual operation of CDU controls is allowed to avoid cycling and disruption of test stability.

9.6 Liquid Pressure Drop Measurement Procedure

9.6.1 Refer to ASHRAE 30. Replace references to liquid-to-refrigerant heat exchangers with liquid-to-liquid heat exchangers.

9.7 Test Point

9.7.1 Refer to Table 9-1 for test points. Test point values shown are based on water on the FWS side of the CDU and 25% Propylene Glycol on the TCS side of the CDU.

9.7.1.1 Test point values are to be adjusted based on the fluid chemistry used in the specific test. Refer to ASHRAE 30 for additional information.

Table 9-1 Test Points – Liquid to Liquid CDU

<i>Test Point^b</i>	<i>FWS Temperatures</i>	<i>TCS Temperatures</i>	
	<i>EFT</i>	<i>LFT</i>	<i>EFT</i>
<i>Full Capacity (100%)</i>	26.7C (80.1F) <i>26.7C (80.1F)</i>	<i>30C (86F)</i>	39.6C (103.3F) <i>39.6C (103.3F)</i>
<i>75% Capacity</i>	26.7C (80.1F) <i>26.7C (80.1F)</i>	<i>30C (86F)</i>	<i>37.2C (99.0F)</i>
<i>50% Capacity</i>	26.7C (80.1F) <i>26.7C (80.1F)</i>	<i>30C (86F)</i>	<i>34.8C (94.6F)</i>
<i>25% Capacity</i>	26.7C (80.1F) <i>26.7C (80.1F)</i>	<i>30C (86F)</i>	<i>32.4C (90.3F)</i>
<i>Minimum Capacity^a</i>	26.7C (80.1F) <i>26.7C (80.1F)</i>	<i>30C (86F)</i>	<i>N/A</i>

a. Minimum capacity test point to be performed with automatic flow controls active at the minimum flow rate at which the CDU automatically maintains TCS side flow within the required flow test tolerances, listed in Table 7-3.

b. Tests for 100%, 75%, 50%, and 25% Capacity are performed at Constant TCS Flow Rate equal to the flow rate used for the 100% Capacity Point.

10. REPORTING OF RESULTS

10.1 General

10.1.1 All data reported from test for Rating will be derived from instrumentation integral to the test facility. Instrumentation integral to the equipment may not be used for data input for Rating.

10.1.2 Report shall identify net cooling capacity (W [Btu/h]).

10.1.3 ~~Total~~ Critical Input power to CDU (W, kW, or MW) as defined in this standard shall be identified.

10.1.4 ~~Excluding power input to integrated liquid pumps~~ Auxiliary Input Power when present (~~refer to Section 6.3.1.7.2~~).

10.1.5 Report shall identify energy efficiency, expressed as energy efficiency ratio (EER), coefficient of performance (COP), or power input per capacity, Btu/W·h or W/W or kW/kW.

Informative Note: It is important to note that pump energy associated with pressure drop through the FWS loop portion of the CDU is not included in the critical input power. This is because any adjustment to the CDU performance would confuse the overall system analysis for capacity and efficiency. It is therefore important for any system analysis to account for the cooling loads associated with the FCS loop pump energy and to include the pump power into the overall equations for system efficiency.

10.1.6 Entering and leaving temperatures (°C [°F]) or leaving liquid temperature and temperature difference (Δ°C [Δ°F]) for TCS loop and FWS loop.

10.1.6.1 ~~Pressure drop of TCS-side available external head pressure loop and FWS-side pressure drop loop~~ kPa (ft of water [at 60°F] or psid).

Informative Note: Due to typical industry practice, liquid pressure drop is often reported in head (kPa [ft of water]); however, test data are acquired in pressure (psid) for use in calculations.

Informative Note: To establish the available external head pressure, the pump is manually set at 100% speed, and valves on the test block are adjusted until the CDU TCS flow reaches the test point value within the required tolerance. The differential pressure is then recorded to establish the TCS-side available external head pressure.

10.1.7 Flow Rate. Liquid flow rate of TCS loop and FWS loop (L/s or m³/h [gpm]) at entering heat exchanger conditions.

10.1.8 Voltage. Nominal voltage (V or kV) and frequency (Hz) for which ratings are valid. For units with a dual nameplate voltage rating, testing shall be performed at the lower of the two voltages. Components that use auxiliary power shall be listed.

10.1.9 Fluid Properties. Identify fluids used on both FWS and TCS side of CDU.

10.1.10 Test Results. Test Results shall be rounded to the number of significant figures identified in Section 3.7 using the definitions in Section 3 and rounding rules and formats in Section 3.7. A written test report shall be generated that contains the data included in Section 5 for each test point at a specific load and set of operating conditions.

10.1.11 Data. For each test point, at a specific load and set of operating conditions, report the test time period and number of data-point measurements. Include the sample mean and sample standard deviation for each measurement value (temperature, flow, pressure drop, power, etc.).

10.1.12 Calculations. Report the correction adjustment values Δp_{adj} and ΔT_{adj} , correction factors CFQ and CF η when applicable, and associated input data used for the correction calculations. Report the density, specific heat capacity, and mass flow values used for capacity calculations. Report all values of Q used in energy balance calculations.

10.1.13 Results. Report the test results following calculations and procedures identified in Sections 3 and 6. Table 10-1 provides a generic summary.

Table 10-1 Results to be Reported

<i>Item</i>	<i>Units of Measure</i>	
	<i>SI</i>	<i>IP</i>
<i>Net cooling capacity (corrected if applicable)</i>	<i>kW or W</i>	<i>Btu/h</i>
<i>Net heat to FWS (corrected if applicable)</i>	<i>kW or W</i>	<i>Btu/h</i>
<i>Input power (W_{input} as applicable)</i>	<i>kW or W</i>	<i>kW or W</i>
<i>Efficiency (corrected if applicable)</i>	<i>COP</i>	<i>EER, or COP</i>
<i>$\Delta p_{available\ TCS}$</i>	<i>kPa</i>	<i>ft of water (at 60°F)</i>
<i>$\Delta p_{corrected\ FWS}$</i>	<i>kPa</i>	<i>ft of water (at 60°F)</i>
<i>Facility Pumping Power Required</i>	<i>kW or W</i>	<i>BHP</i>
<i>TCS Pump Turndown Ratio</i>	<i>Ratio</i>	<i>ratio</i>
<i>Energy balance</i>	<i>%</i>	<i>%</i>
<i>Net Heat Rejection to Space Ambient</i>	<i>kW or W</i>	<i>Btu/h</i>
<i>Unit Power Factor</i>	<i>PF</i>	<i>PF</i>
<i>Voltage balance</i>	<i>%</i>	<i>%</i>

10.1.14 Additional Information to Report

- 10.1.14.1** Name and address of the CDU test facility
- 10.1.14.2** Report identification number and disclaimer
- 10.1.14.3** Description of test CDU, including model and serial numbers
- 10.1.14.4** Date and time of tests
- 10.1.14.5** Instrumentation and calibration list from test facility

11. NOMENCLATURE

11.1 Some symbols use a subscript suffix; multiple subscripts are separated by a comma. Refer to ASHRAE 30 for information regarding use of units and converting equations based on other units of measure.

Table 11-1 Nomenclature

Group	Symbol	Description	SI	IP		
			Unit Name	Unit Symbol	Unit Name	Unit Symbol
General						
	CF	correction factor for atmospheric pressure adjustment				
	E	energy flow rate (thermal or electrical)	watt	W	British thermal unit (IT) per second	Btu/s
	E _{bal}	energy balance				
	L	length dimension	metre	m	foot	ft
	W	width dimension	metre	m	foot	ft
	H	height dimension	metre	m	foot	ft
	n	rotational speed (such as motor or compressor)	revolution per minute	rpm	revolution per minute	rpm
	t	time	second	s	second	s
		date and time display formats: dd-mmm-yyyy hh:mm:ss.s				
	Δt	time interval	second	s	second	s
	Tol	tolerance				
	V	voltage	volt	V	volt	V
	W	power, rate at which work is performed	watt	W	watt	W
	θ	sensitivity coefficient for uncertainty				
	ω	frequency (electrical)	hertz	Hz	hertz	Hz
Flow						
	m	mass flow rate	kilogram per second	kg/s	pound per second	lb/s
	V	volumetric flow rate	cubic metre per second	m ³ /s	cubic foot per second	ft ³ /s
	ρ	density	kilogram per cubic metre	kg/m ³	pound per cubic foot	lb/ft ³
Capacity						
	Q	net capacity, heat flow rate	watt	W	British thermal unit (IT)	Btu/h
	Q'	gross capacity, heat flow rate	watt	W	British thermal unit (IT)	Btu/h
	Q%	percent load				
	c _p	specific heat at constant pressure	kilojoule per kilogram kelvin	kJ/(kg·K)	British thermal unit (IT) per pound degree Fahrenheit	Btu/(lb·°F)

	<i>h</i>	<i>enthalpy</i>	<i>kilojoule per kilogram</i>	<i>kJ/kg</i>	<i>British thermal unit (IT) per pound</i>	<i>Btu/lb</i>
--	----------	-----------------	-------------------------------	--------------	--	---------------

<i>Group</i>	<i>Symbol</i>	<i>Description</i>	<i>SI</i>	<i>IP</i>		
			<i>Unit Name</i>	<i>Unit Symbol</i>	<i>Unit Name</i>	<i>Unit Symbol</i>
	Δh	<i>enthalpy differential</i>	<i>kilojoule per kilogram</i>	<i>kJ/kg</i>	<i>British thermal unit (IT) per pound</i>	<i>Btu/lb</i>
	T	<i>temperature</i>	<i>degree Celsius</i>	$^{\circ}\text{C}$	<i>degree Fahrenheit</i>	$^{\circ}\text{F}$
	ΔT	<i>temperature differential (temperature interval)</i>	<i>degree Celsius</i>	$\Delta^{\circ}\text{C}$	<i>degree Fahrenheit</i>	$\Delta^{\circ}\text{F}$
<i>Efficiency</i>						
	η	<i>efficiency, COP</i>	<i>watt per watt</i>	$W/W = 1$	<i>watt per watt</i>	$W/W = 1$
<i>Pressure Drop</i>						
	d	<i>pipe inside diameter dimension</i>	<i>millimetre</i>	<i>mm</i>	<i>inch</i>	<i>in</i>
	p	<i>pressure</i>	<i>kilopascal</i>	<i>kPa</i>	<i>pound-force per square inch</i>	<i>psia</i>
	Δp	<i>pressure differential</i>	<i>kilopascal</i>	<i>kPa</i>	<i>pound-force per square inch</i>	<i>psid or ft of water (at 60°F)</i>

Table 11-2 Subscripts

<i>Subscripts</i>	<i>Description</i>	<i>Subscripts (contd.)</i>	<i>Description</i>
<i>atm</i>	<i>atmospheric</i>	<i>mean</i>	<i>mean, referring to arithmetic mean</i>
<i>avg</i>	<i>average, equivalent to arithmetic mean</i>	<i>Q</i>	<i>capacity</i>
<i>corrected</i>	<i>corrected value representing an adjustment to a test value</i>	<i>test</i>	<i>test, result from a test measurement</i>
<i>DB</i>	<i>dry bulb, referring to temperature</i>	<i>w</i>	<i>water</i>
<i>FL</i>	<i>full load, referring to rated capacity at design conditions</i>	<i>X%</i>	<i>denoting a value for X% part load capacity (i.e., 75%)</i>
<i>i</i>	<i>index value</i>	<i>η</i>	<i>efficiency</i>
<i>in</i>	<i>inlet, entering, input</i>		
<i>input</i>	<i>input</i>		
<i>j</i>	<i>index value</i>		
<i>liq</i>	<i>liquid</i>		
<i>FWS</i>	<i>Facility Water System</i>		
<i>TCS</i>	<i>Technology Cooling System</i>		

Addendum b to Standard 127 rennumbers existing Section 6 to Section 12.

12. CONFORMANCE

Addendum b to Standard 127 rennumbers existing Section 7 to Section 13. Addendum b further modifies Section 13 as shown:

13. REFERENCES

12. ASHRAE. 2019. ANSI/ASHRAE Standard 30, *Method of Testing Liquid Chillers*. Atlanta: ASHRAE.
13. ASHRAE. ANSI/ASHRAE Standard 181, *Methods of Testing for Rating Liquid to Liquid Heat Exchangers*. Atlanta: ASHRAE.
14. ASHRAE. 2013. ANSI/ASHRAE Standard 41.1, *Standard Method for Temperature Measurement*. Atlanta: ASHRAE.
15. ASHRAE. 2016. ANSI/ASHRAE Standard 41.8, *Standard Methods for Liquid Flow Measurement*. Atlanta: ASHRAE.
16. ASME. 2004 (R2013). ASME Standard PTC 19.5, *Flow Measurement*. New York: American Society of Mechanical Engineers.
17. ASME. 2014. ASME Standard MFC-16, *Measurement of Liquid Flow in Closed Conduits With Electromagnetic Flowmeters*. New York: American Society of Mechanical Engineers.
18. ASME. 2004. ASME Standard MFC-3M, *Measurement of Fluid Flow in Pipes Using Orifice, Nozzle, and Venturi*. New York: American Society of Mechanical Engineers.
19. ASME. 2005. ASME Standard MFC-6M-1998 (R2005), *Measurement of Fluid Flow in Pipes Using Vortex Flowmeters*. New York: American Society of Mechanical Engineers.
20. ASME. 2006. ASME Standard MFC-11, *Measurement of Fluid Flow by Means of Coriolis Mass Flowmeters*. New York: American Society of Mechanical Engineers.

21. ISA. 1977. ISA Standard RP31.1, Recommended Practice Specification, Installation, and Calibration of Turbine Flowmeters. Research Triangle Park, NC: Instrument Society of America.
22. ASME. 2010 (R2015). ASME Standard PTC 19.2, Pressure Measurement, Instruments and Apparatus Supplement. New York: American Society of Mechanical Engineers.
23. ASHRAE. 2014. ANSI/ASHRAE Standard 41.11, Standard Methods for Power Measurement. Atlanta: ASHRAE.
24. IEEE. 2016. IEEE C57.13, IEEE Standard Requirements for Instrument Transformers. New York: Institute of Electrical and Electronic Engineers.

Addendum b to Standard 127 adds new Informative Appendix G and Normative Appendix H as follows:

INFORMATIVE APPENDIX G

USE OF STANDARD FOR APPLICATION TESTING

This standard defines the Method of Test for Rating of Data Center Cooling Equipment. The intent is to enable products to be compared for steady-state capacity and efficiency based on a defined set of standard performance points. It is imperative to understand this document does not define method of testing equipment for transient response, project-specific applications, control stability, or other similar parameters. It is common to test equipment at project- or application-specific operating points or under specific operating conditions which do not fall under this standard. These alternative tests are Application Tests. Measurement points, instrumentation requirements, and other parameters defined within this standard may be used as reference to develop an independent test regimen or facility for an Application Test but should not be confused with or inferred to be a test complying with this standard.

NORMATIVE APPENDIX H

MEASUREMENT POINTS FOR LIQUID TO LIQUID CDUS

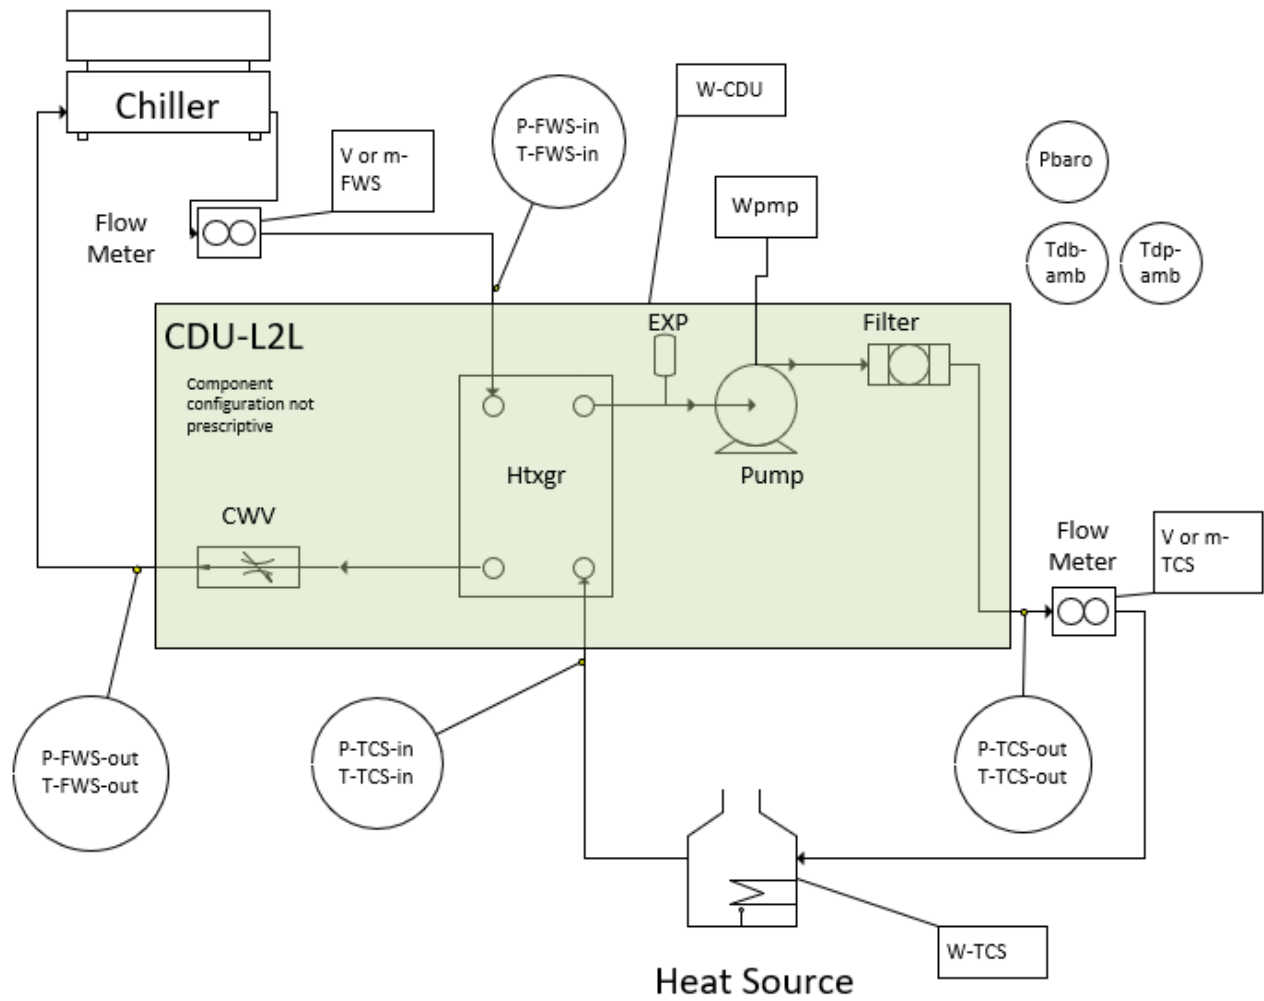


Table H-1 Test Measurement Points

	<i>Description</i>	<i>Units</i>	
		<i>SI</i>	<i>IP</i>
m_{FWS}	Mass flow rate of the FWS working fluid into the CDU	kg/s	(lb/s)
m_{TCS}	Mass flow rate of the TCS working fluid out of the CDU	kg/s	(lb/s)
V_{FWS}	Volume flow rate of the FWS working fluid into the CDU	m ³ /s	(ft ³ /s)
V_{TCS}	Volume flow rate of the TCS working fluid out of the CDU	m ³ /s	(ft ³ /s)
P_{FWS-in}	FWS liquid pressure entering the CDU	kPa	(psia)
T_{FWS-in}	FWS liquid temperature entering the CDU	°C	(°F)
$P_{FWS-out}$	FWS liquid pressure leaving the CDU	kPa	(psia)
$T_{FWS-out}$	FWS liquid temperature leaving the CDU	°C	(°F)
P_{TCS-in}	TCS liquid pressure entering the CDU	kPa	(psia)
T_{TCS-in}	TCS liquid temperature entering the CDU	°C	(°F)
$P_{TCS-out}$	TCS liquid pressure leaving the CDU	kPa	(psia)
$T_{TCS-out}$	TCS liquid temperature leaving the CDU	°C	(°F)
P_{baro}	Barometric pressure surrounding the CDU	kPa	(psia)
T_{DBamb}	Dry bulb temperature -temperature surrounding CDU during test	°C	(°F)
T_{DPAmb}	Dew point temperature temperature surrounding CDU during test	°C	(°F)
W_{CDU}	Electrical power supplied to the CDU	W	W
W_{pmp}	Electrical power supplied to the CDU Pump (optional)	W	W
W_{TCS}	Power supplied to the TCS fluid	W	W